


Calhoun County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

203 Total Samples




- > 10 32%
- 5-10 12%
- < 5 16%
- Non-Detect 40%



0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

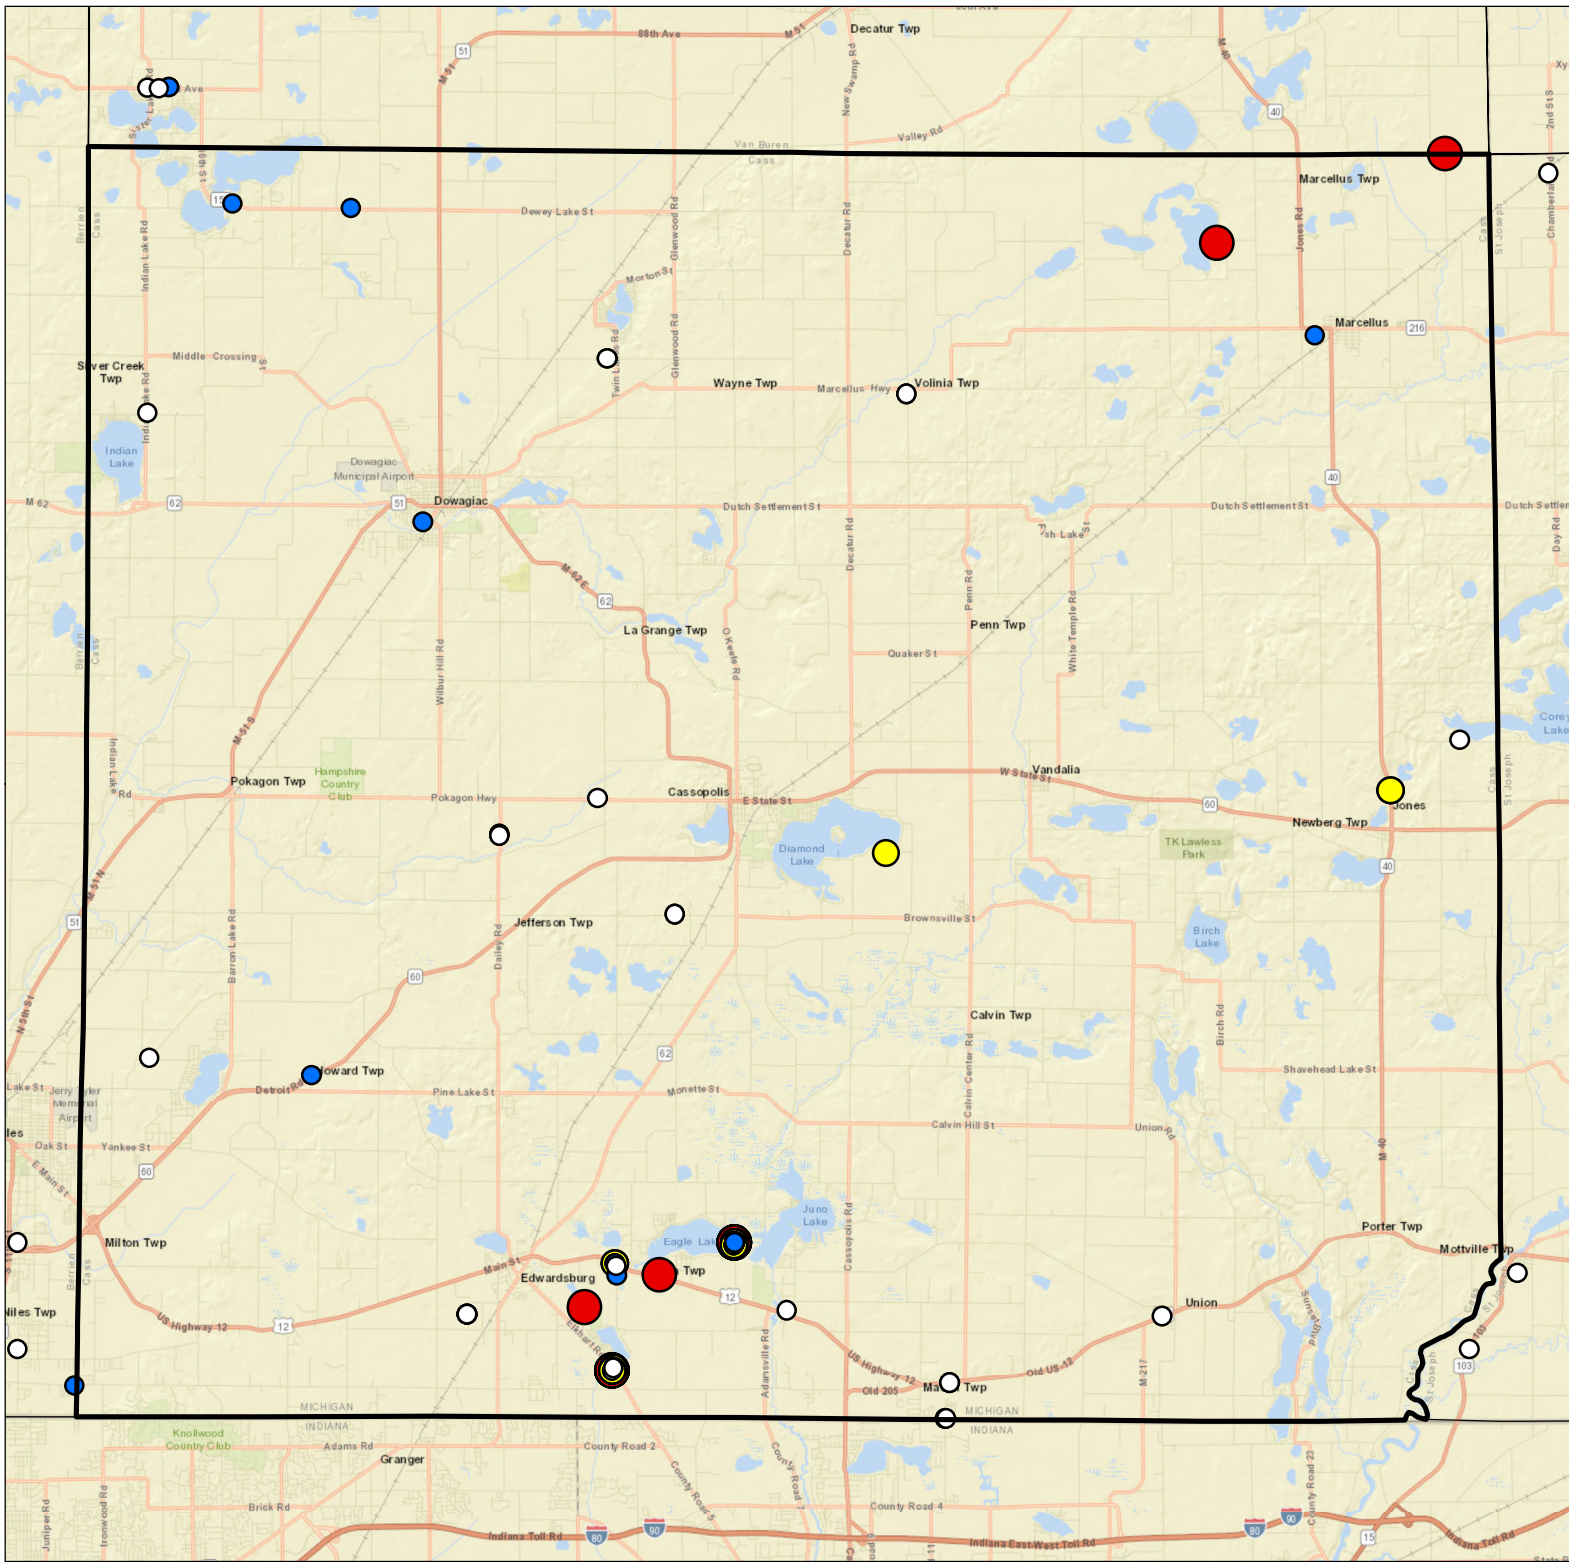


Cass County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


99 Total Samples



- > 10 7%
- 5-10 27%
- < 5 42%
- Non-Detect 24%



Source: Waterchem database
Map Created November 2019

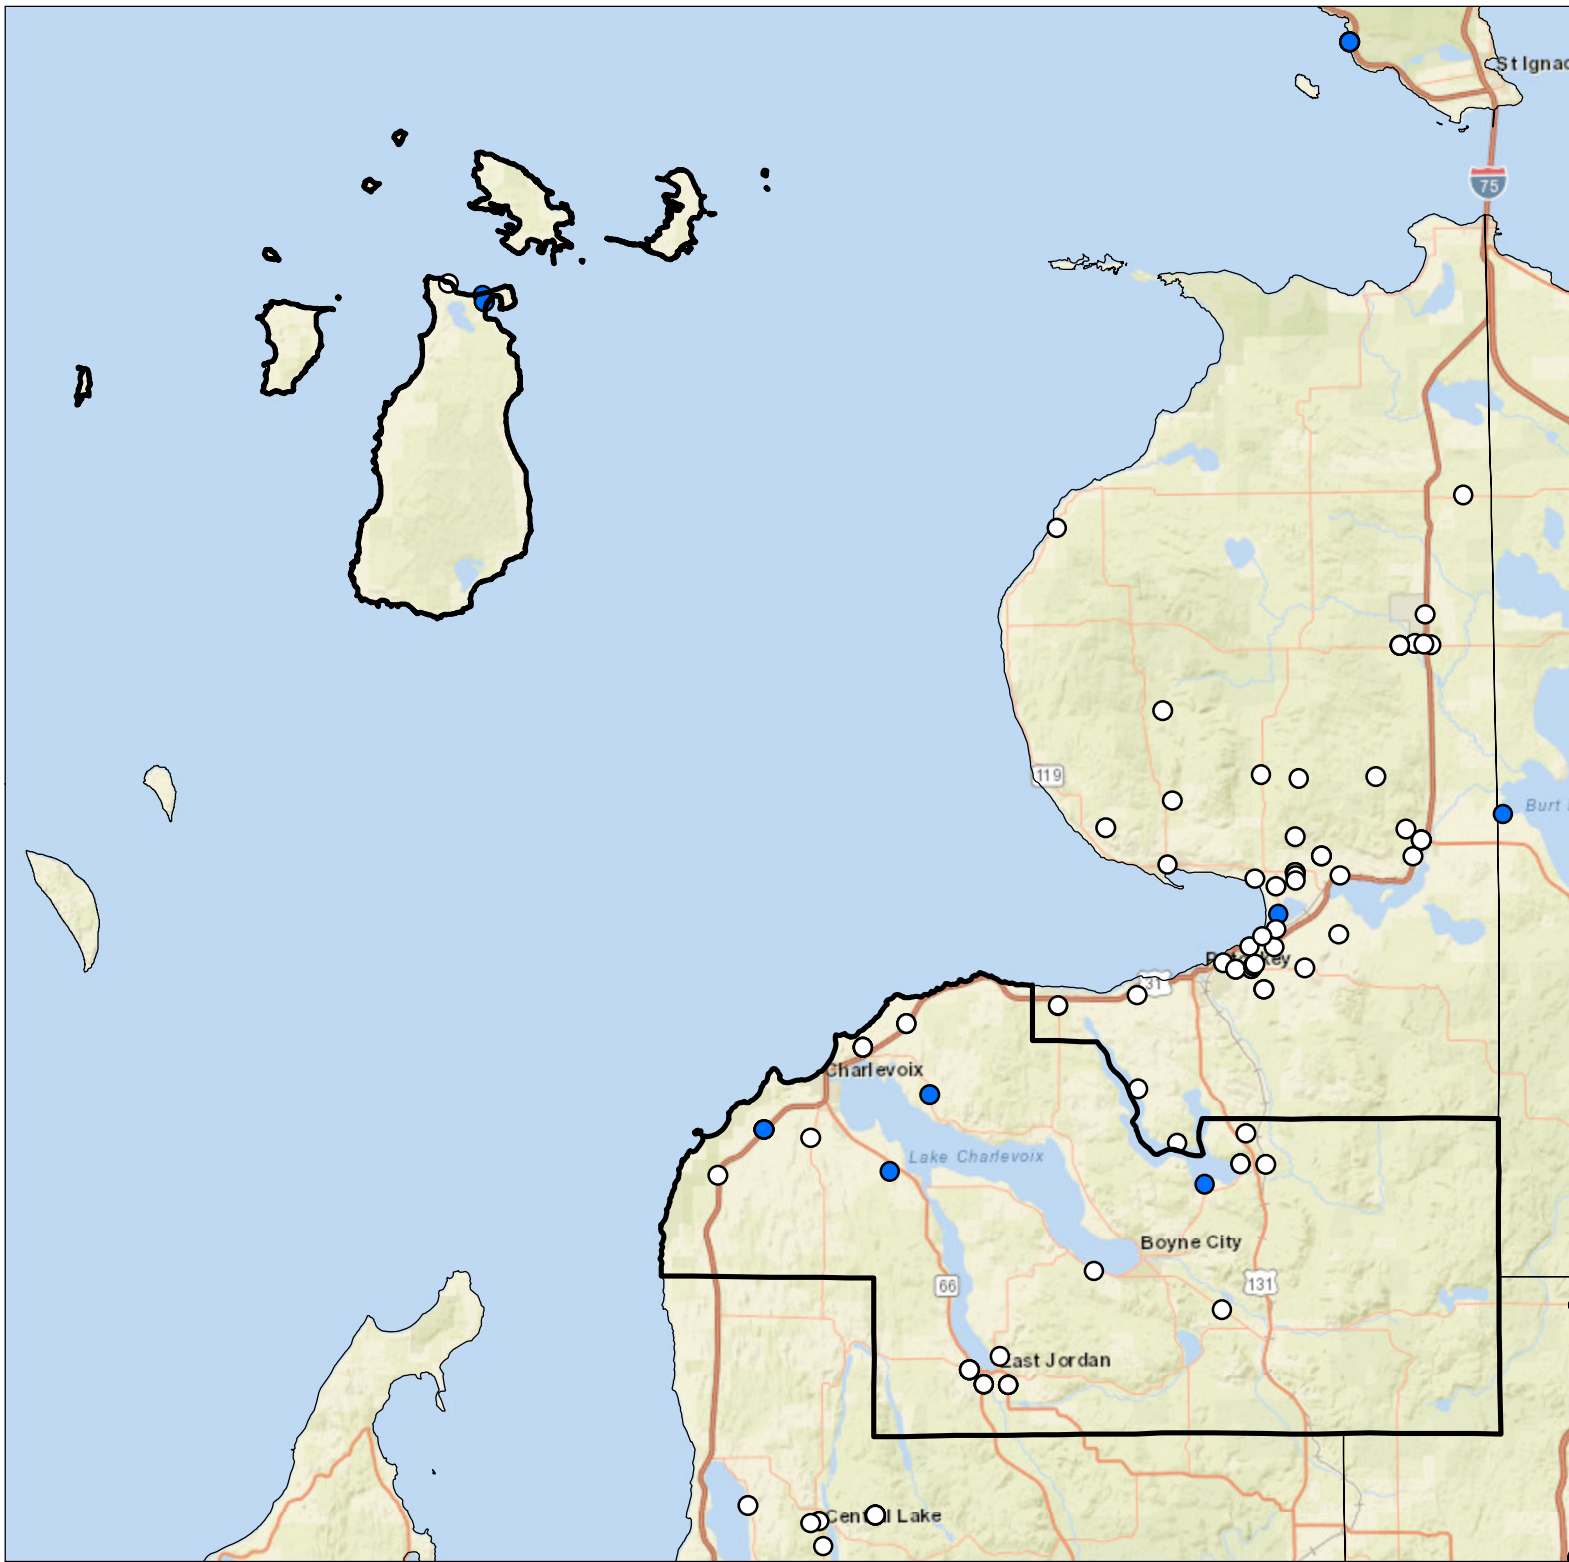


Charlevoix County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

30 Total Samples



- > 10 0%
- 5-10 0%
- < 5 30%
- Non-Detect 70%



EGLE

0 2 4 8 Miles



Source: Waterchem database
Map Created November 2019

Cheboygan County Drinking Water Arsenic Results




Chippewa County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

25 Total Samples



- > 10 0%
- 5-10 0%
- < 5 8%
- Non-Detect 92%




EGLE

0 3 6 12 Miles



Source: Waterchem database
Map Created November 2019

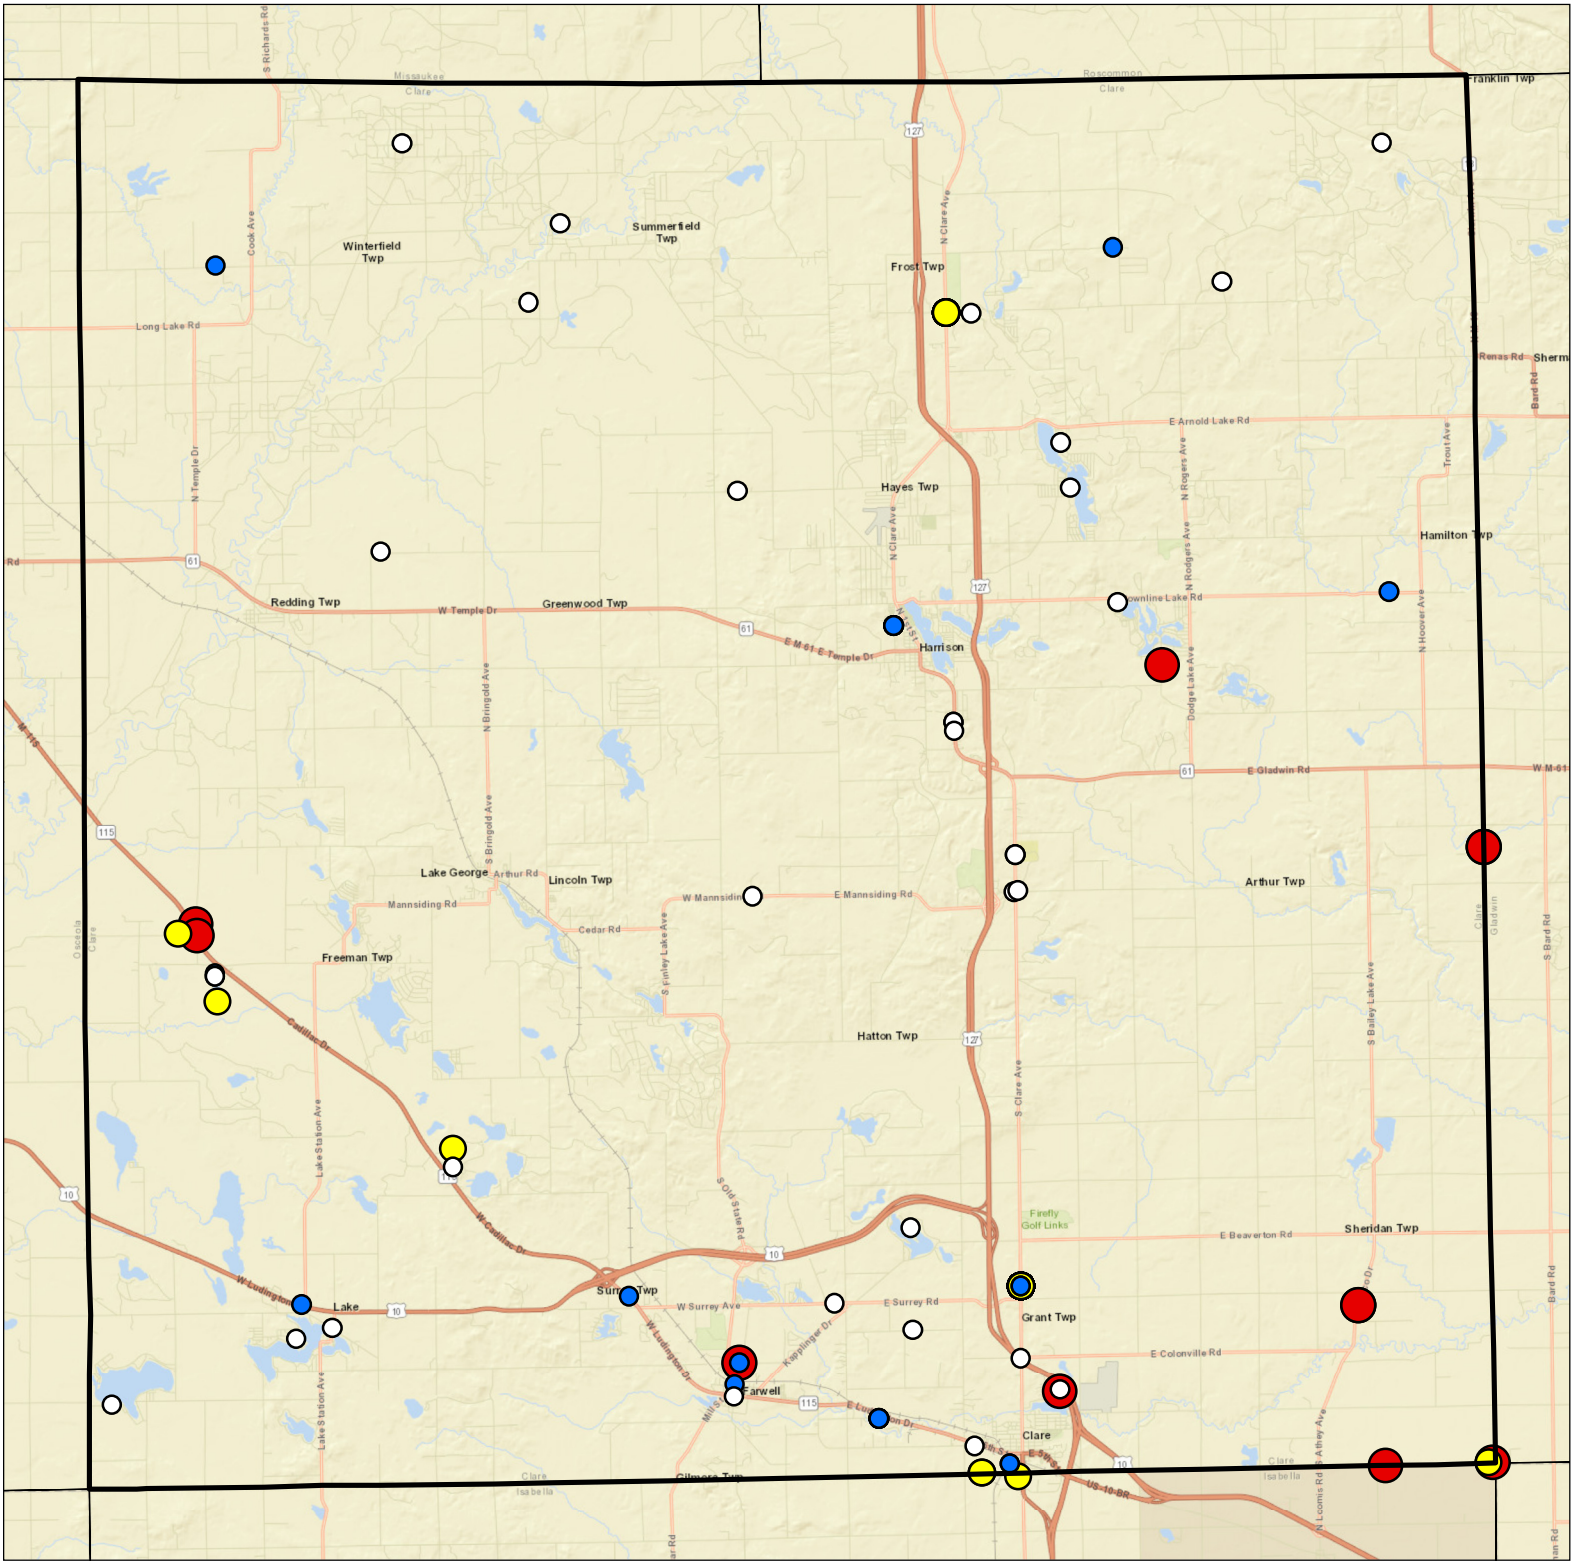


Clare County Drinking Water Arsenic Results


Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB


85 Total Samples



- > 10 11%
- 5-10 33%
- < 5 20%
- Non-Detect 36%



Source: Waterchem database
Map Created November 2019

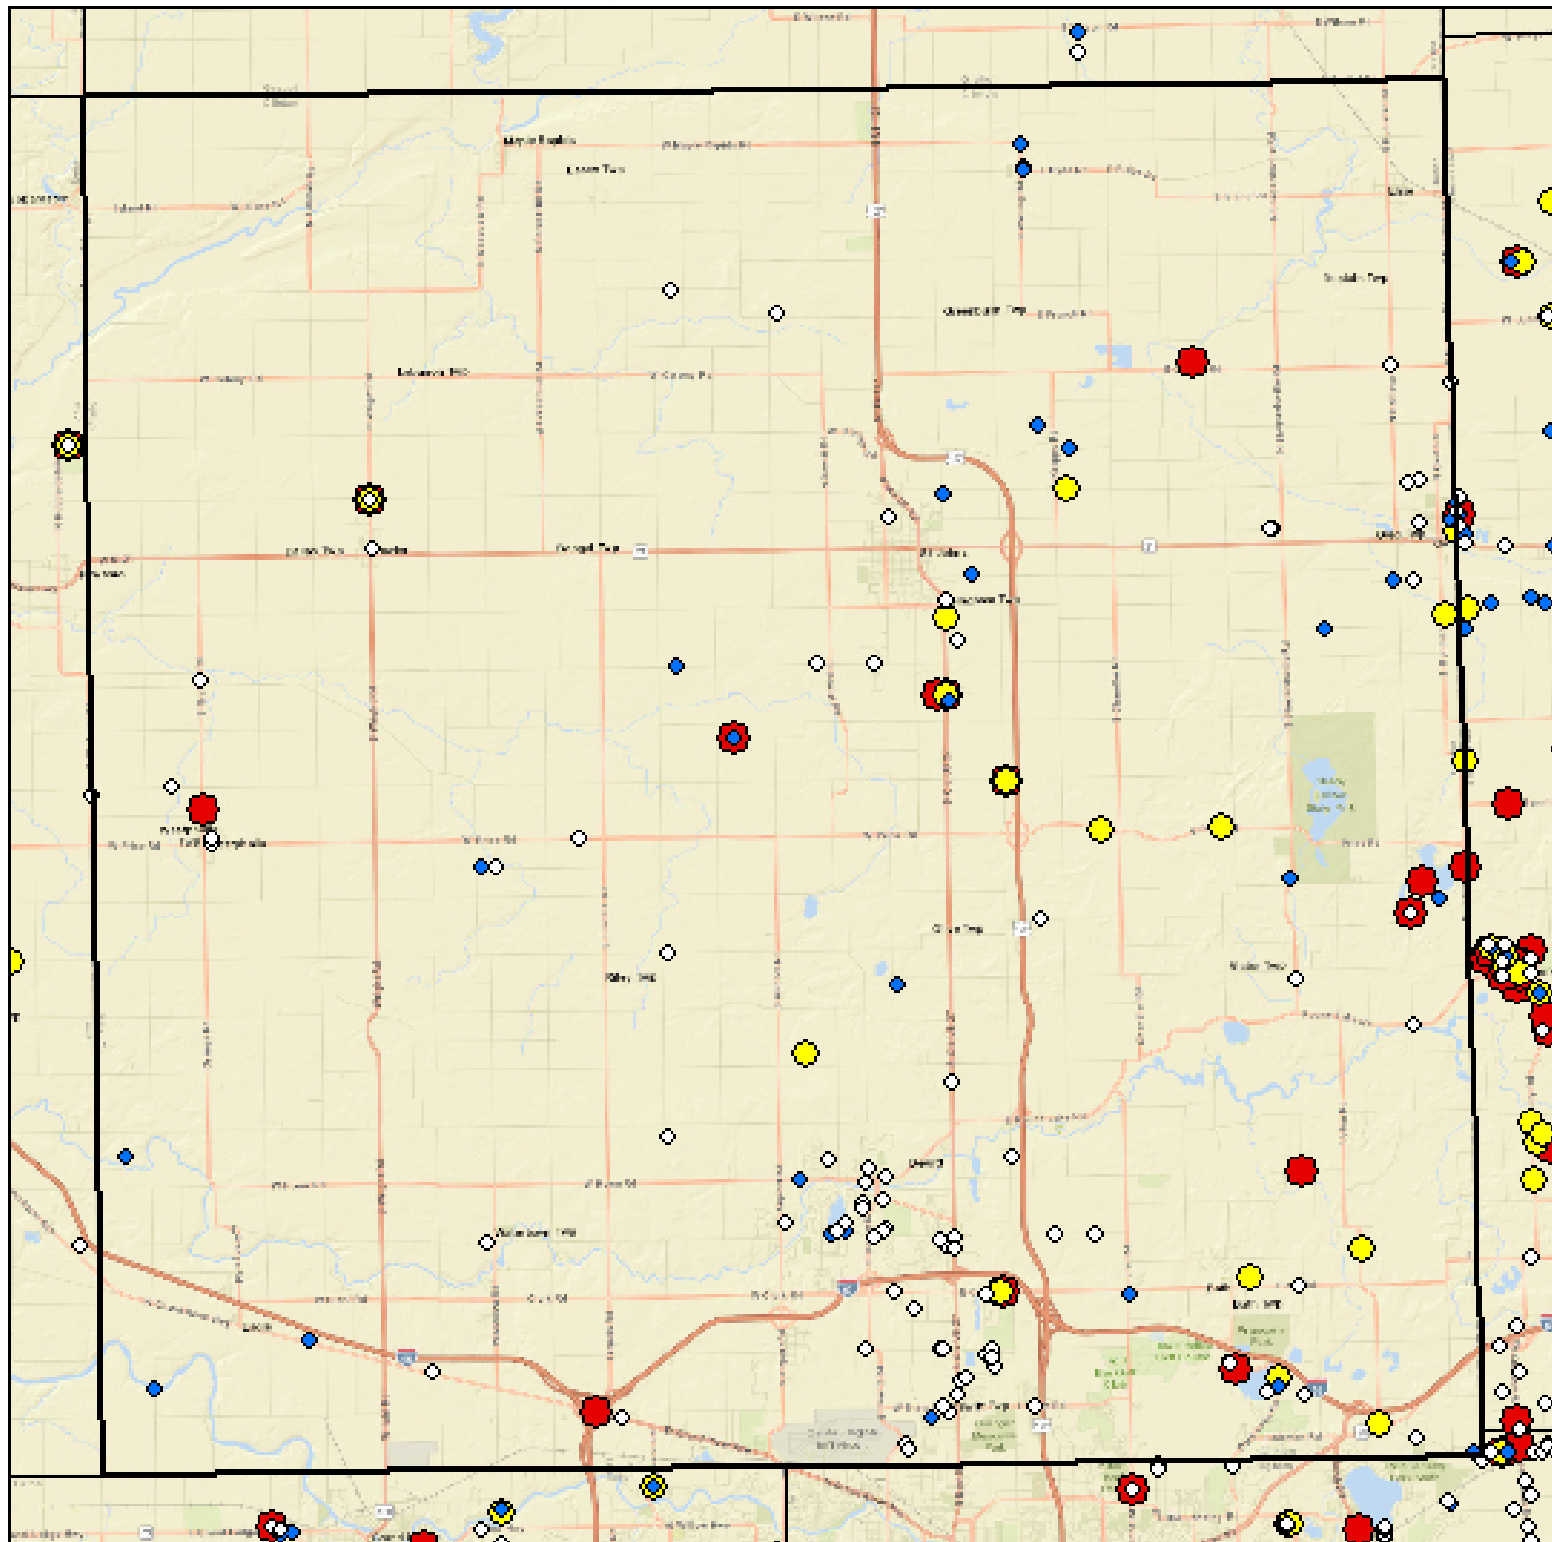


Clinton County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

321 Total Samples




- > 10 6%
- 5-10 13%
- < 5 17%
- Non-Detect 64%



0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

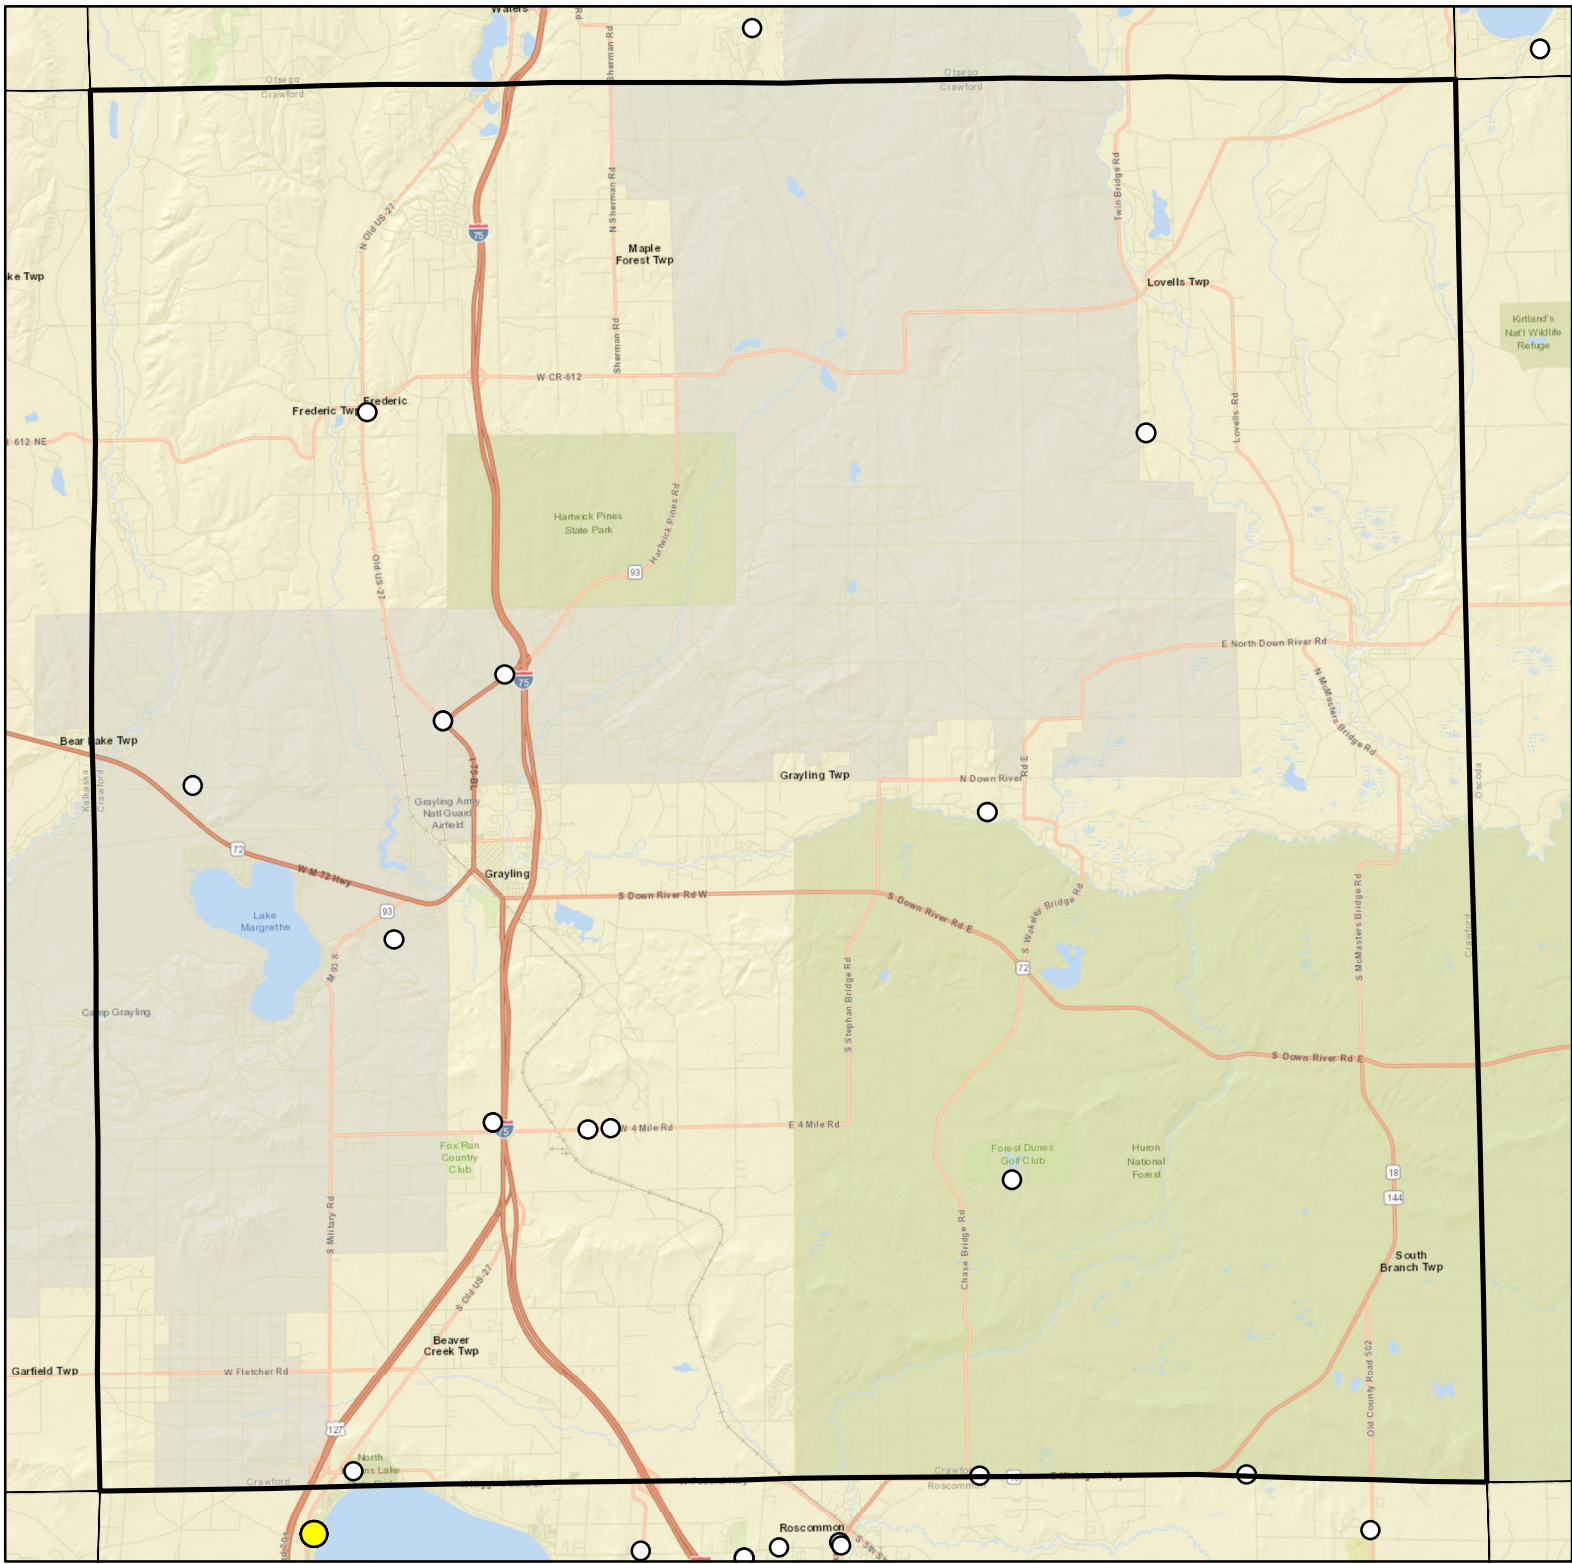


Crawford County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

20 Total Samples



- > 10 0%
- 5-10 0%
- < 5 0%
- Non-Detect 100%




EGLE

0 1 2 4 Miles



Source: Waterchem database
Map Created November 2019

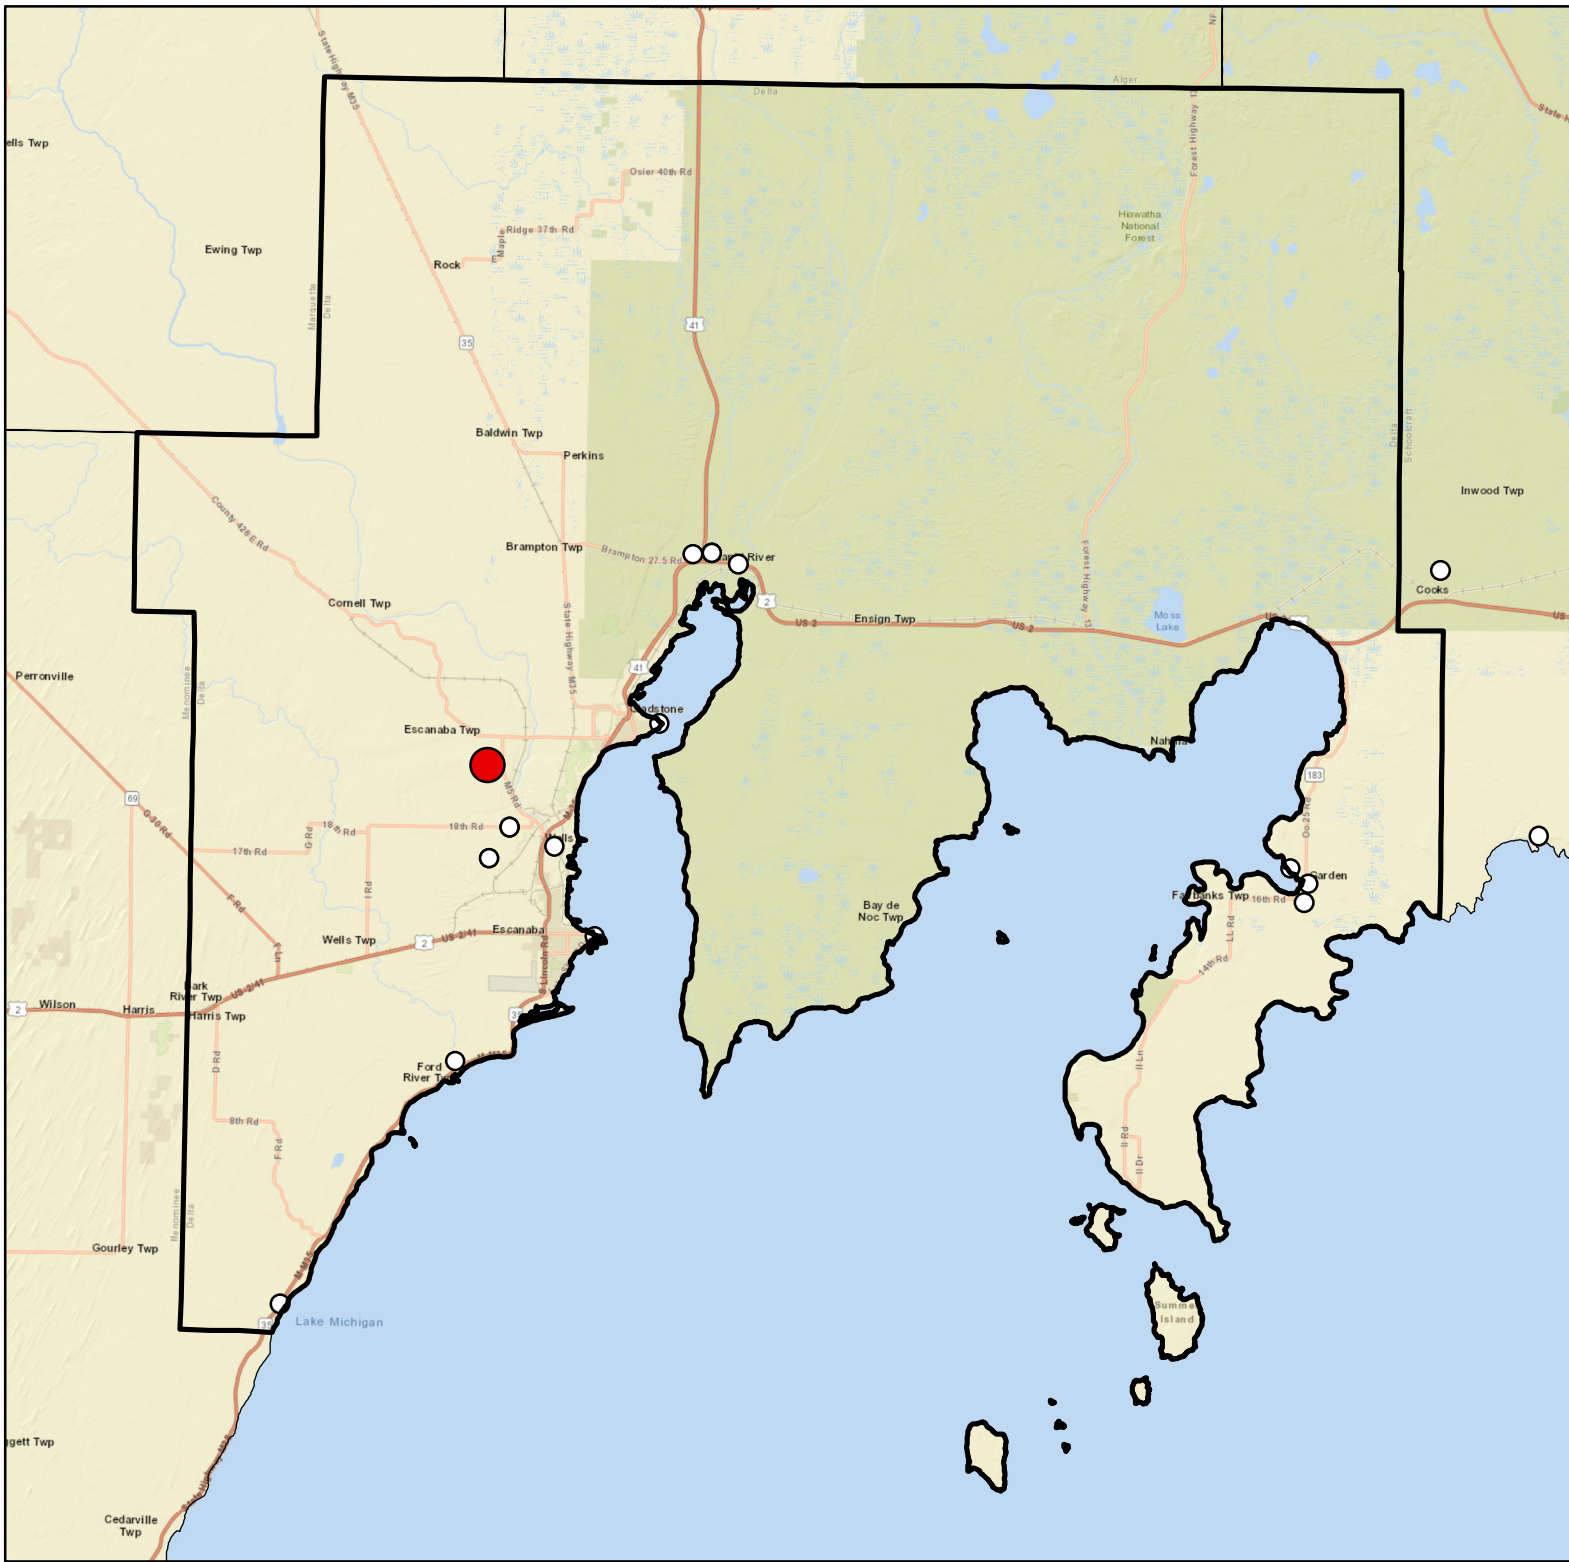


Delta County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

16 Total Samples



- > 10 6%
- 5-10 0%
- < 5 0%
- Non-Detect 94%




EGLE

0 2 4 8 Miles



Source: Waterchem database
Map Created November 2019

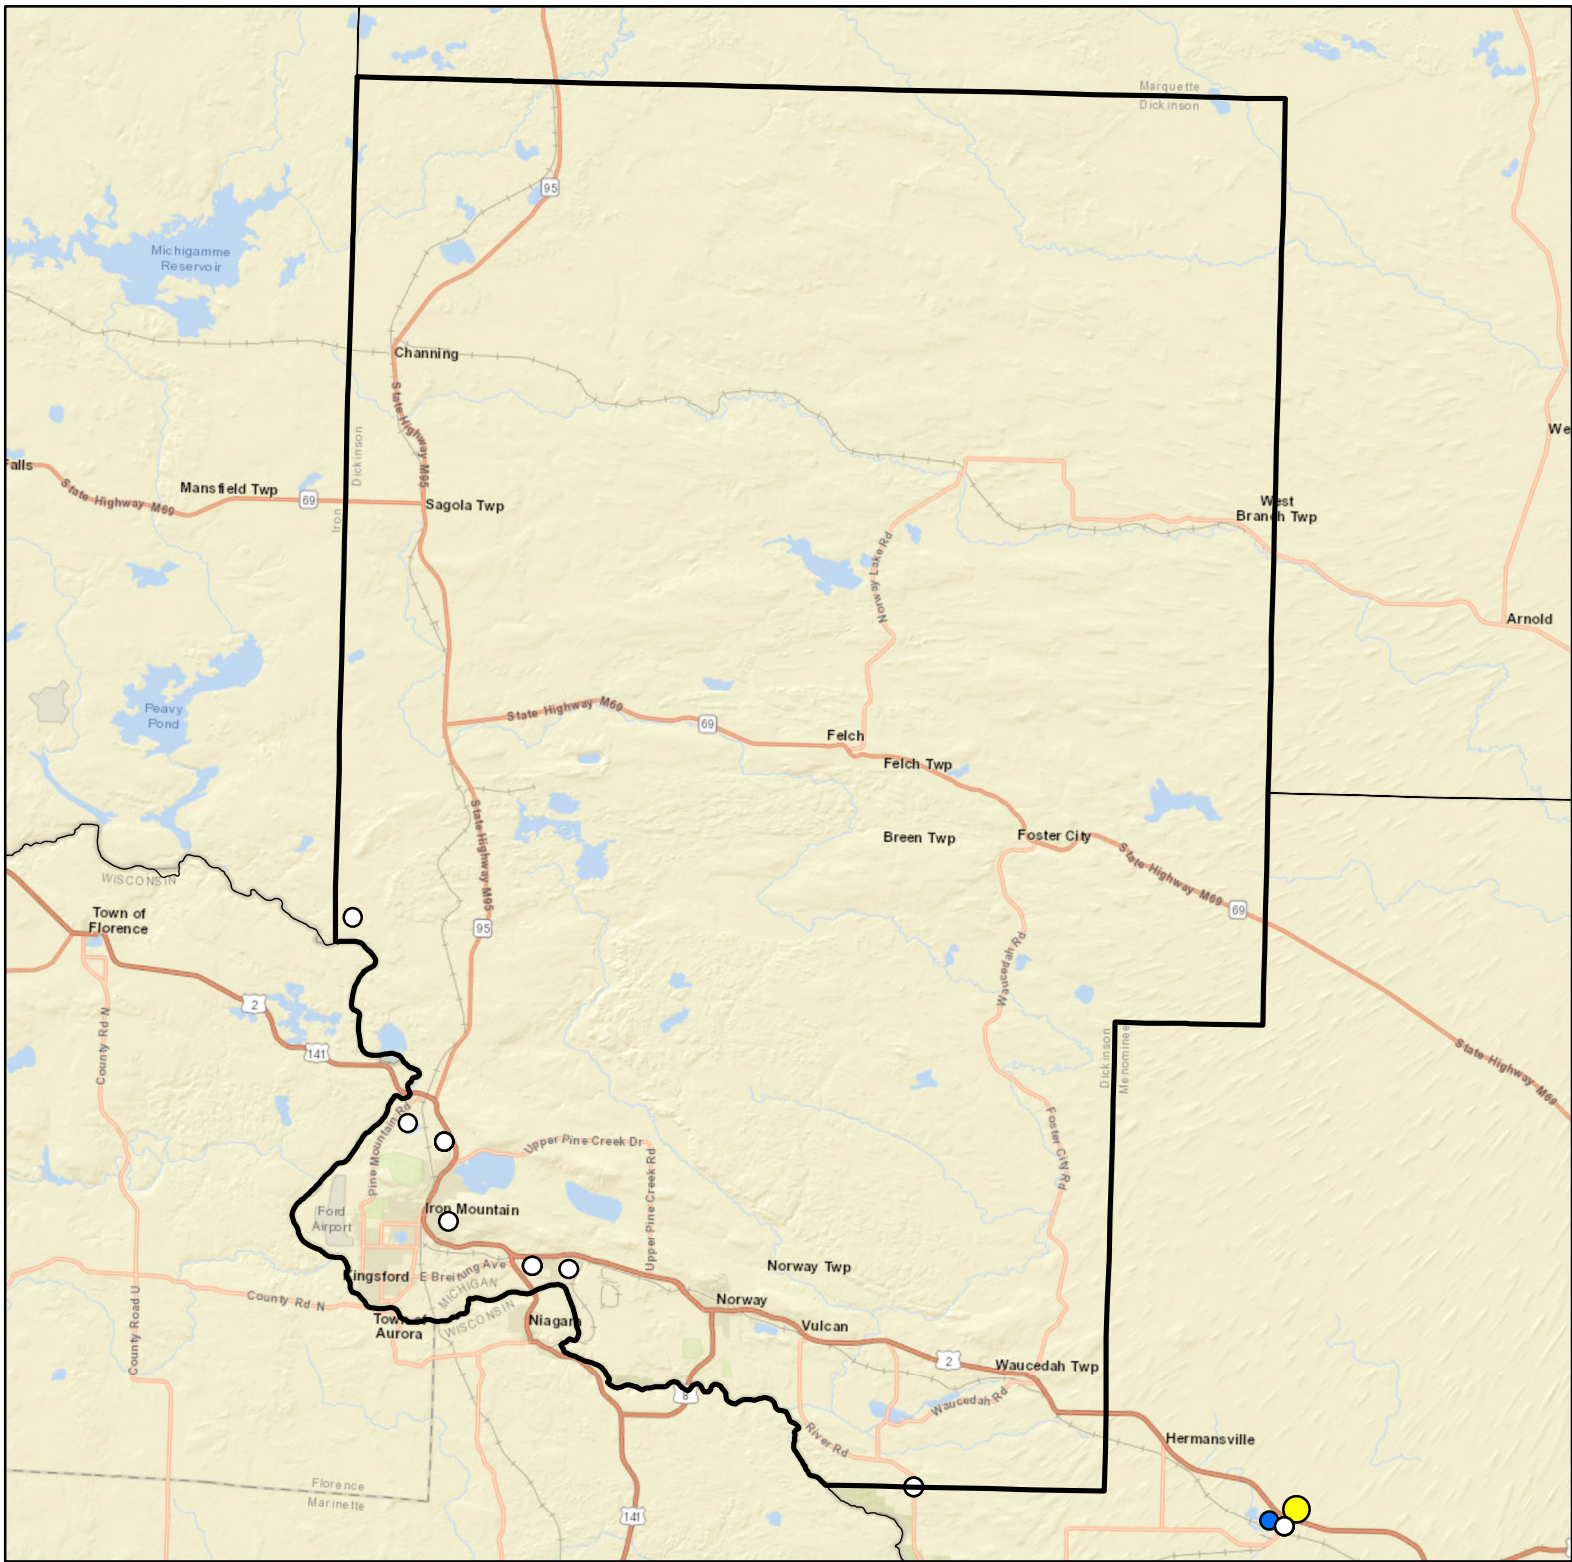


Dickinson County Drinking Water Arsenic Results

Legend

- Arsenic Sample Results Non-Detect
- Arsenic Sample Results <5 PPB
- Arsenic Sample Results 5-10 PPB
- Arsenic Sample Results >10 PPB

7 Total Samples



- > 10 0%
- 5-10 0%
- < 5 0%
- Non-Detect 100%



EGLE

0 1.5 3 6 Miles



Source: Waterchem database
Map Created November 2019